


[illegible]


Blue Text = BY OTHERS

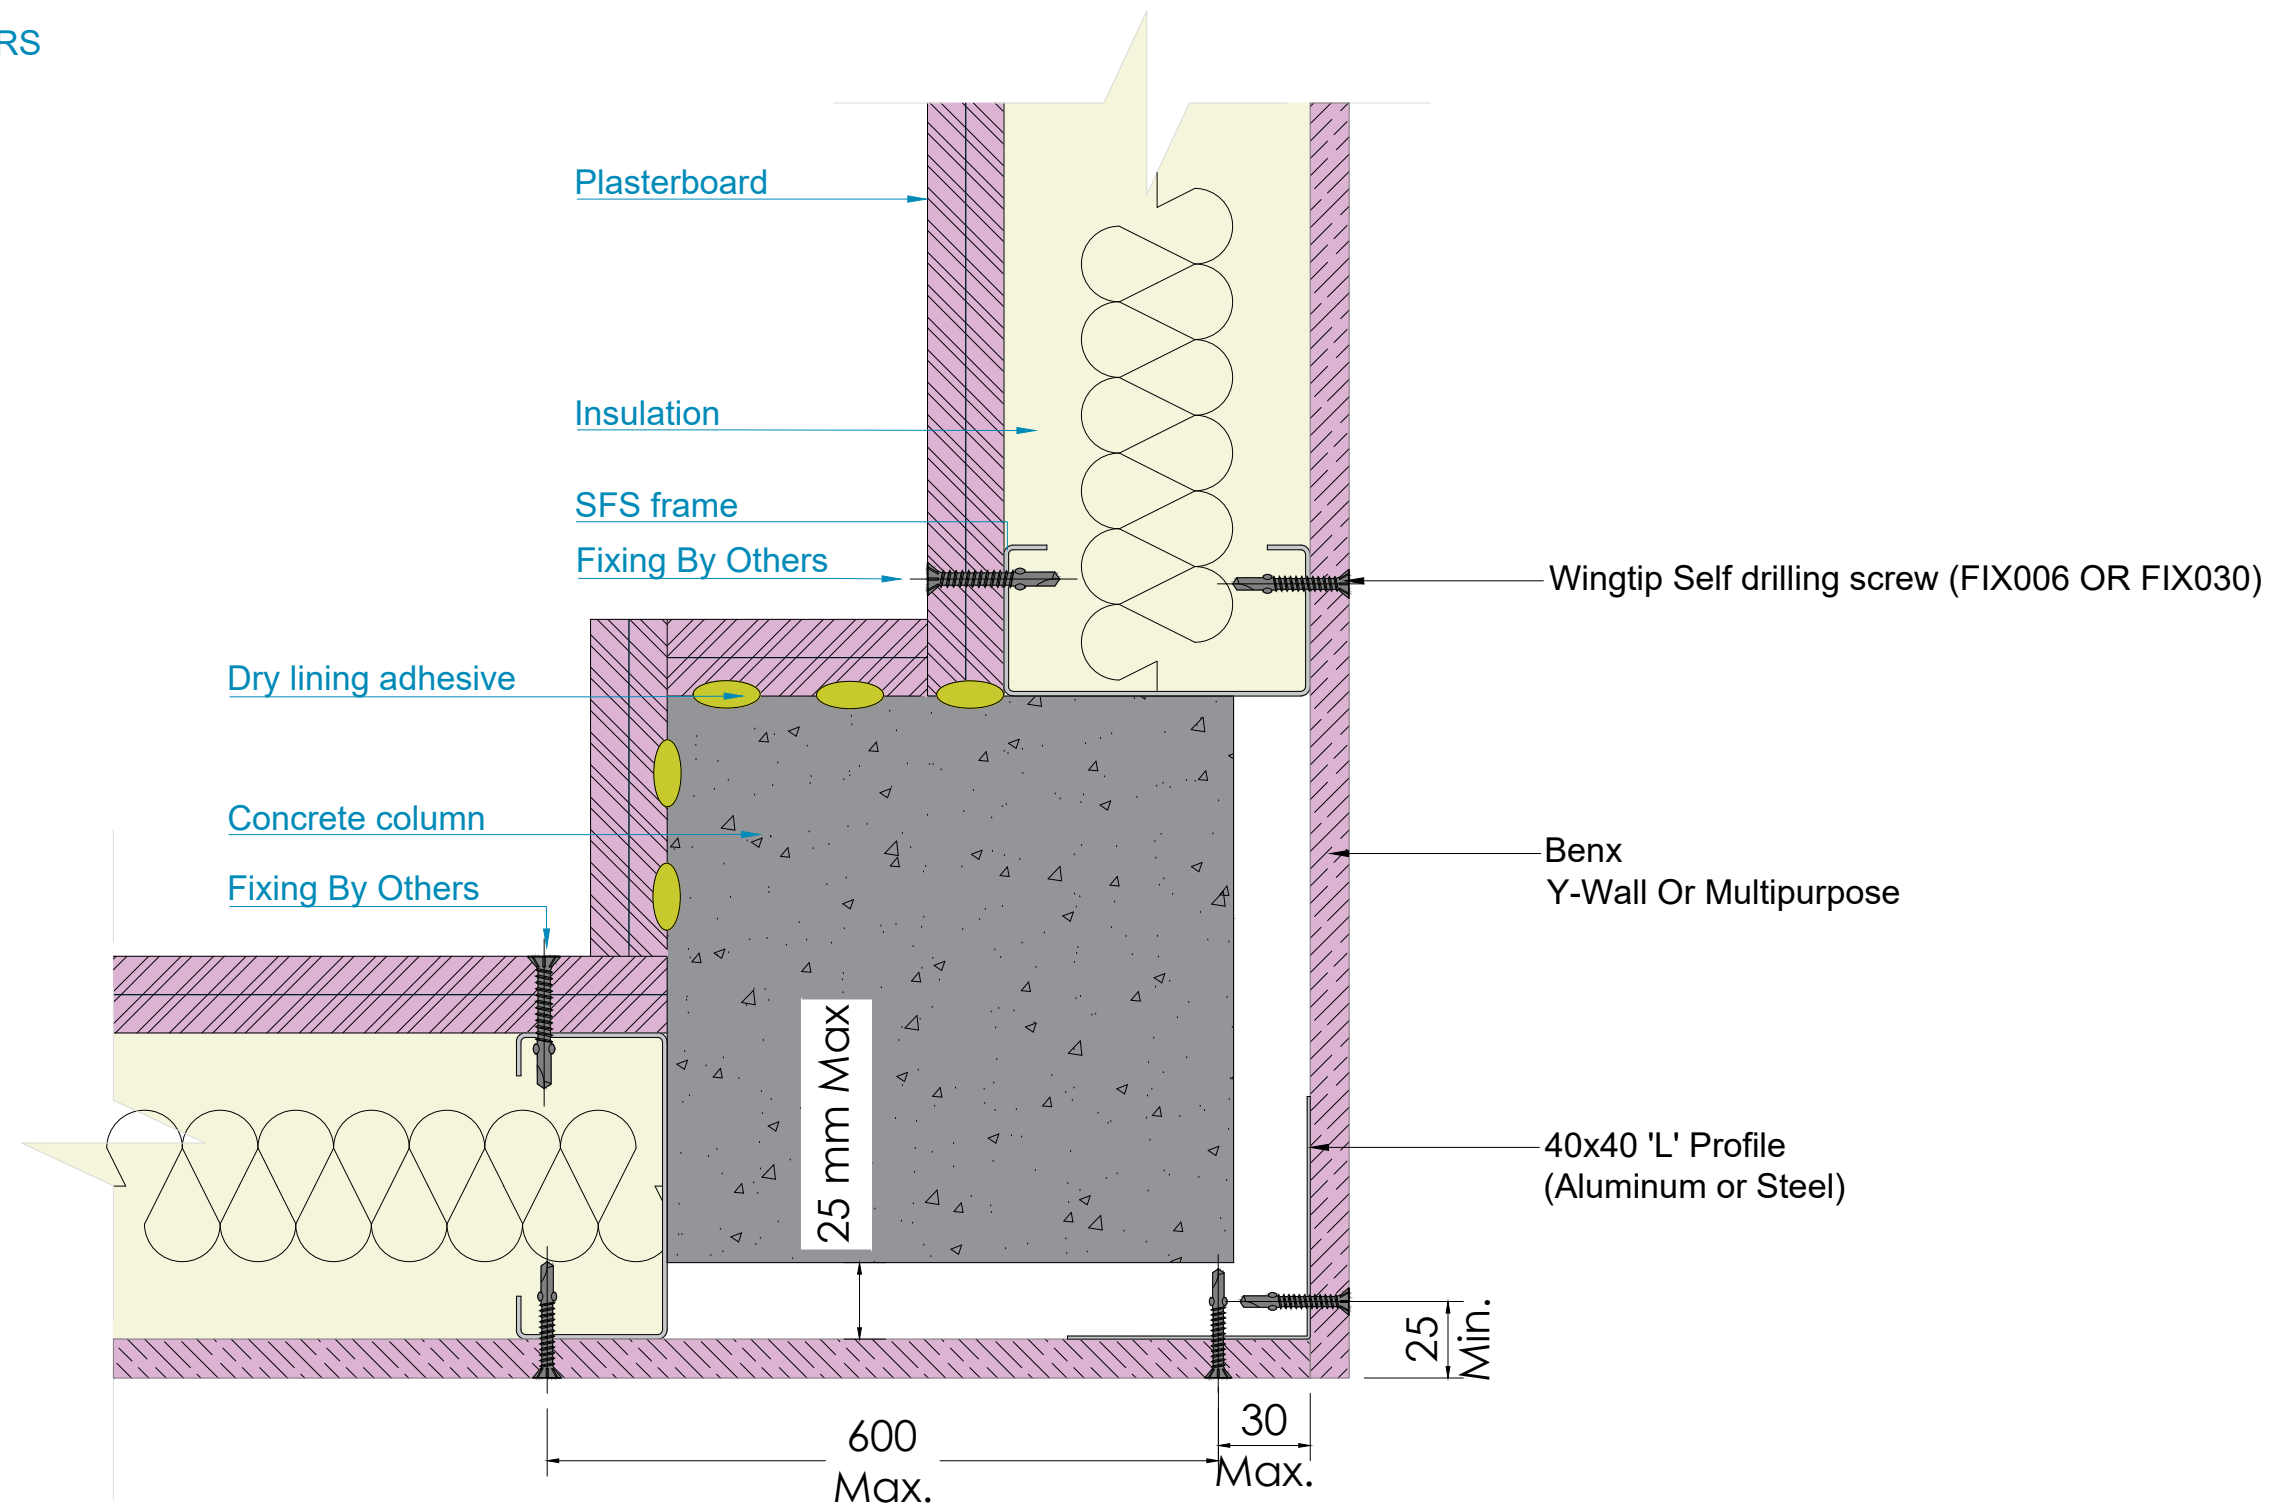

Technical Note:

All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.


Blue Text = BY OTHERS

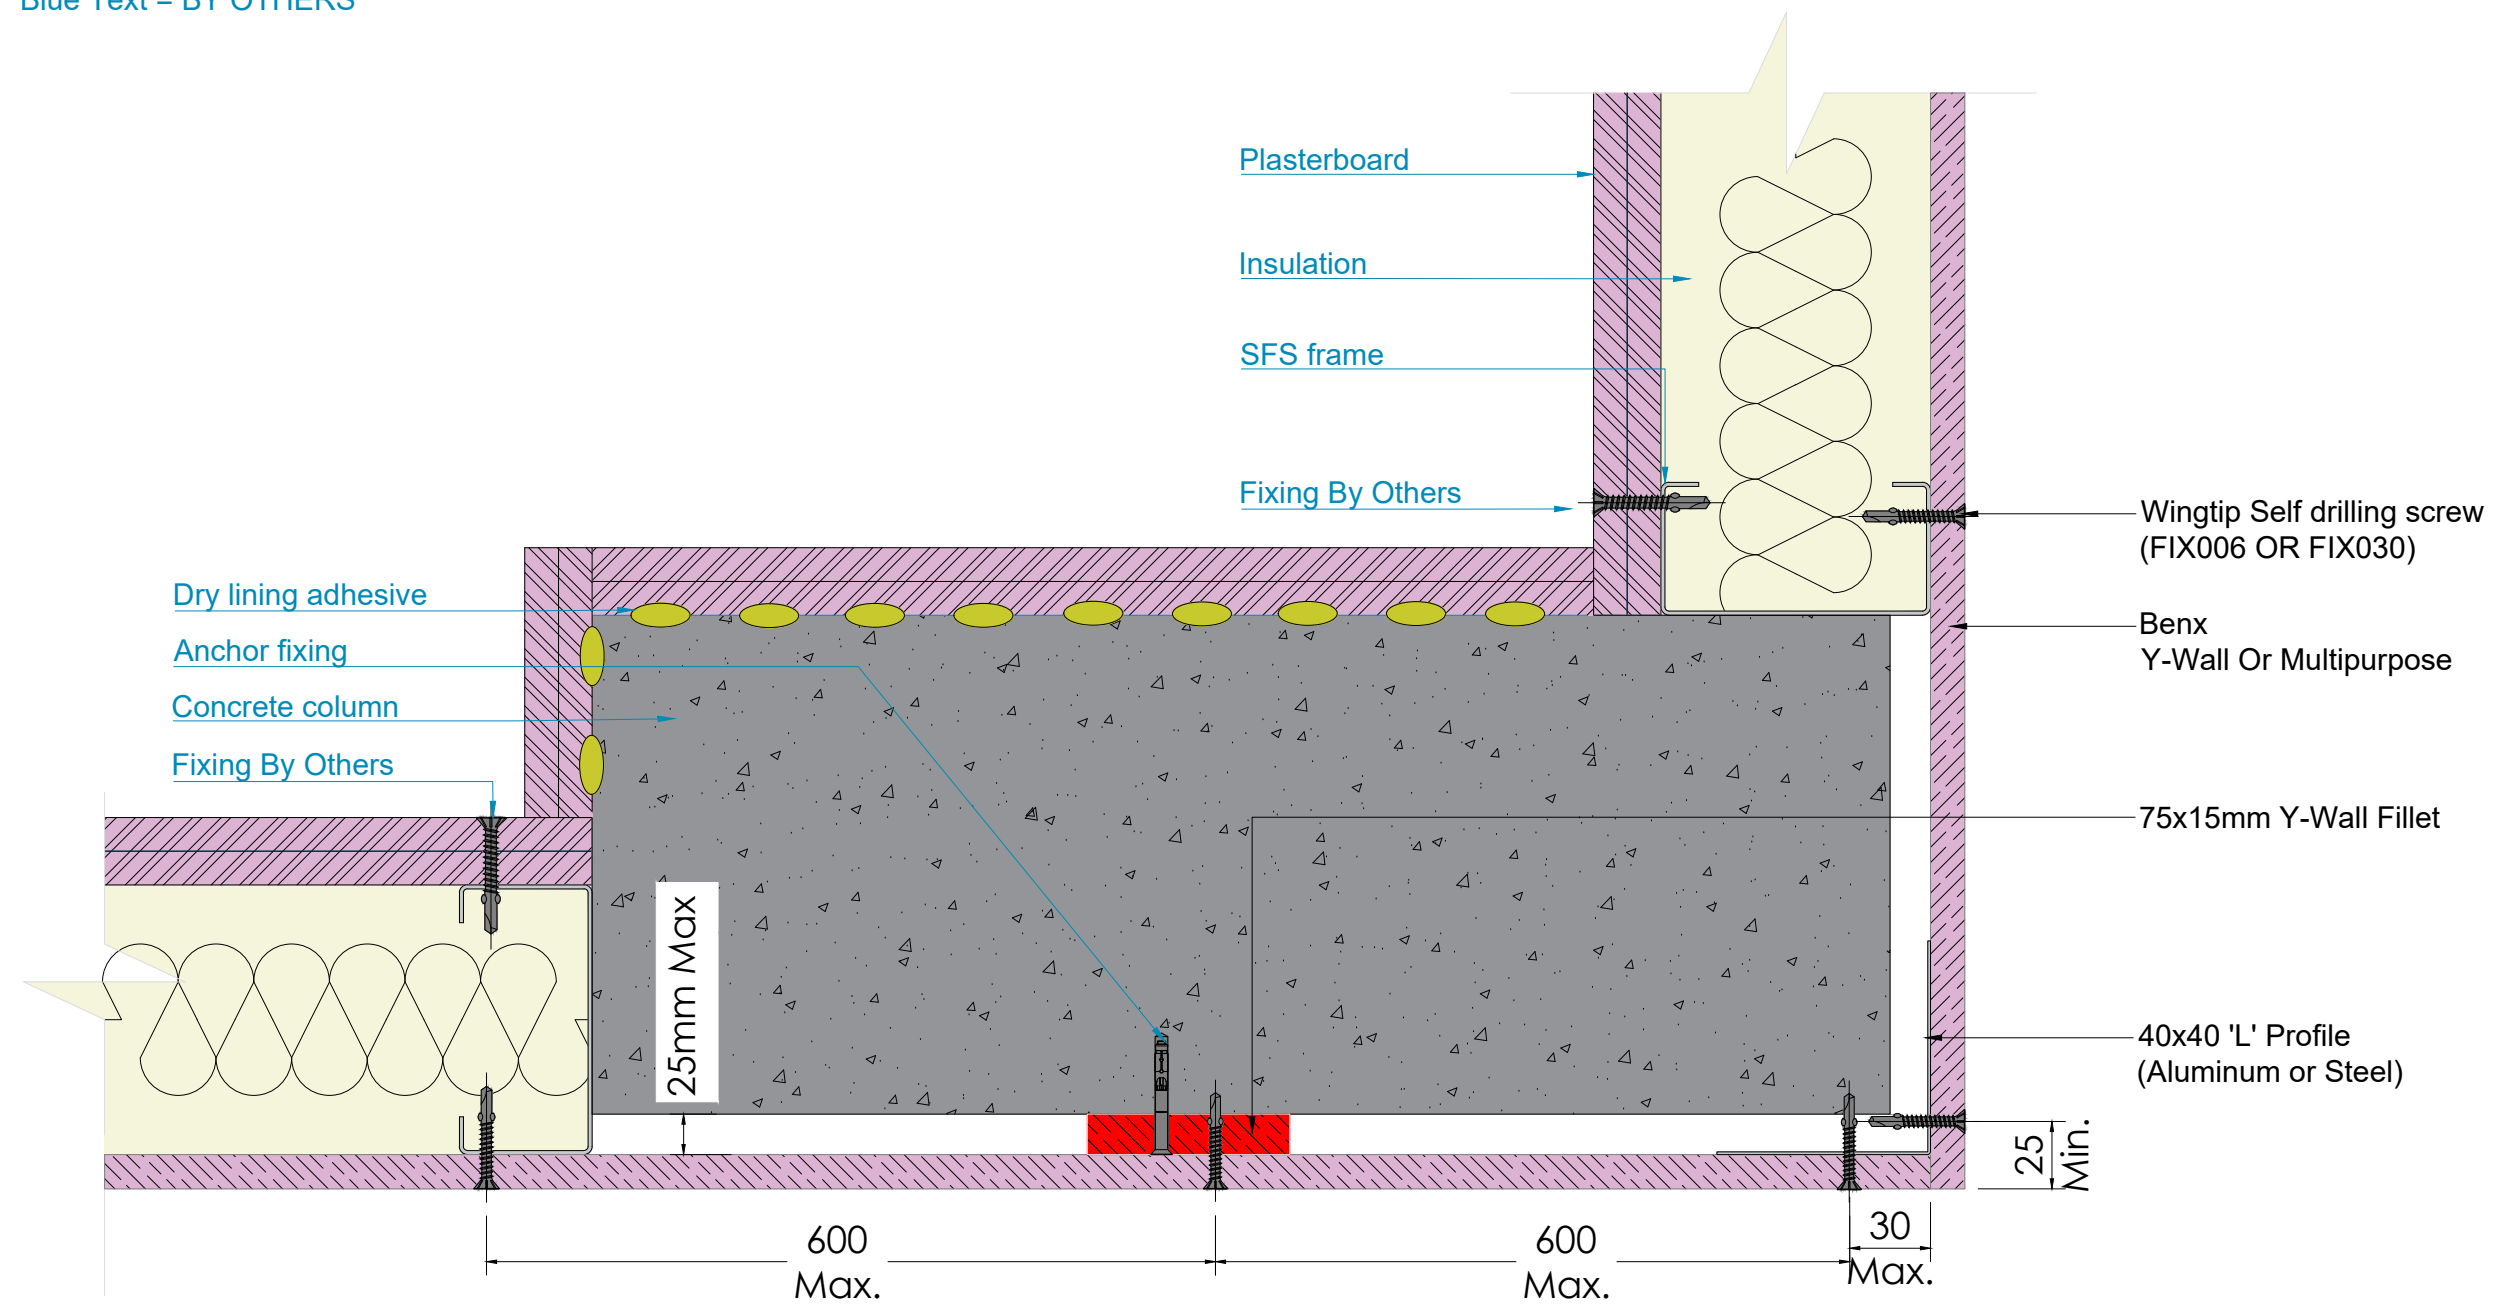

Technical Note:

All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Blue Text = BY OTHERS

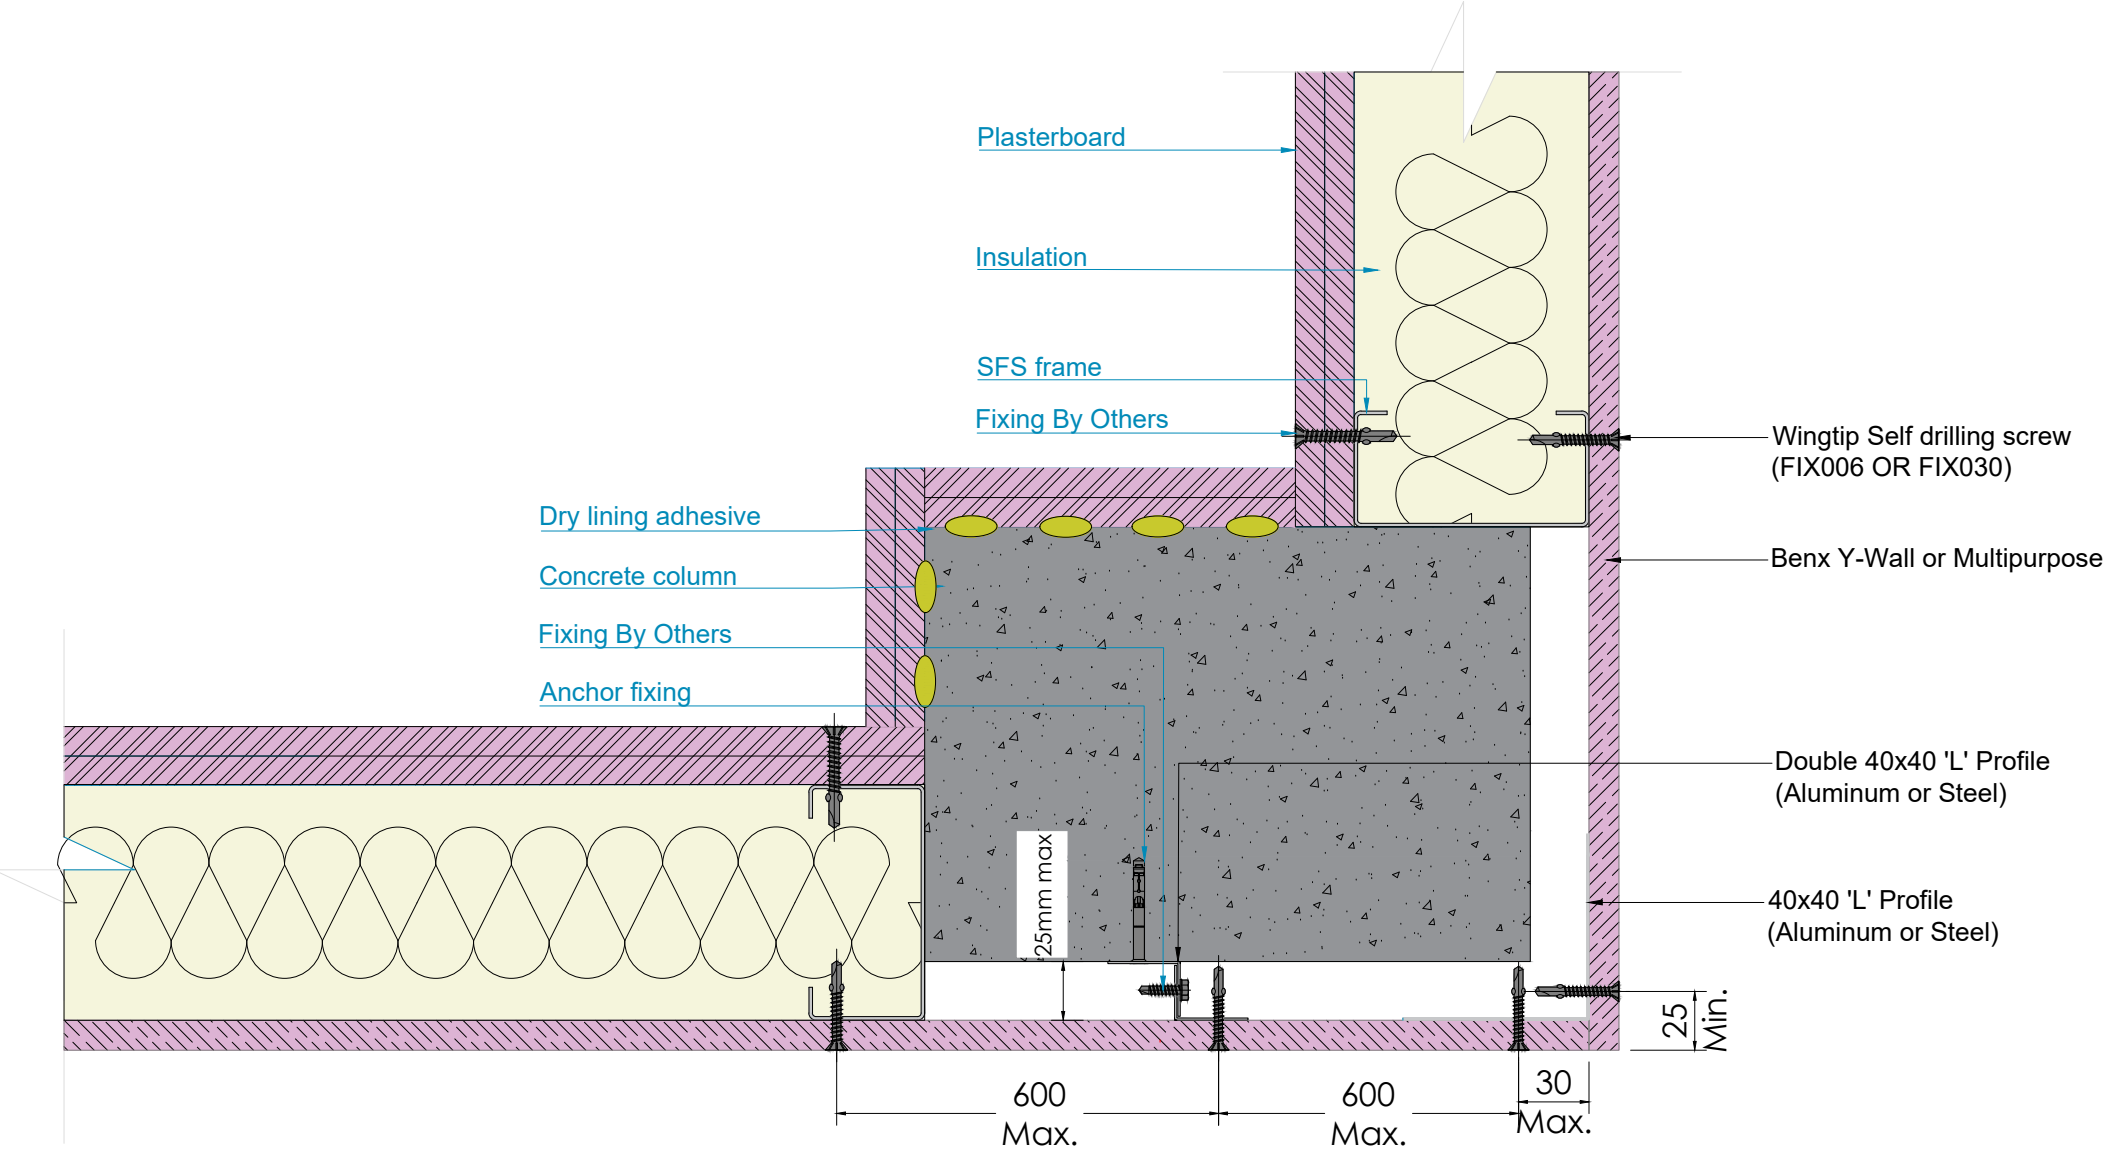

Technical Note:


All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Benx Ltd, Lonsdale Chambers,
Lonsdale Street,
Stoke-on-Trent
Staffordshire
ST4 4BT
Telephone: 0845 130 0983
Email:
technicalservices@benx.co.uk

All performance data & systems specifications are for systems constructed with materials & components as shown. The inclusion or substitution of any other manufactures materials or components invalidates both test data, system performance and compliance with CDM 2015. The information is provided and based upon details received, which are assumed to include all the relevant facts and data. While it is believed to be correct, we accept no liability for its accuracy, adequacy or completeness. Recipients must satisfy themselves as to its suitability as we do not accept responsibility for any claims or consequential loss. Acceptance of the content and subsequent design responsibility rests entirely with the recipients. Any subsequent design changes that affect the detail which we are not informed of in a written format will void this detail. None of the content may be copied without the prior approval from the Benx Group Technical Services Department. This statement should be read in conjunction with the standard terms and conditions of Benx Group.

REV	DATE	NOTE	BY	STATUS:	AG	MB	INFORMATION	DRAWN:
A	16/11/21	First Issue	AG	PROJECT:	AG	MB	Building Boards Typical Details	MB
B	01/06/26	Details Updated	AG	ISO No:	AG	MB	5450	DS
				DRAWING No:			BB-TD-04	NTS@A3
				DESCRIPTION:			TYPICAL CORNER DETAIL ON "L Profiles" - Variable Slab Depth	DATE:
								06/26
								REV:
								A


Blue Text = By Others

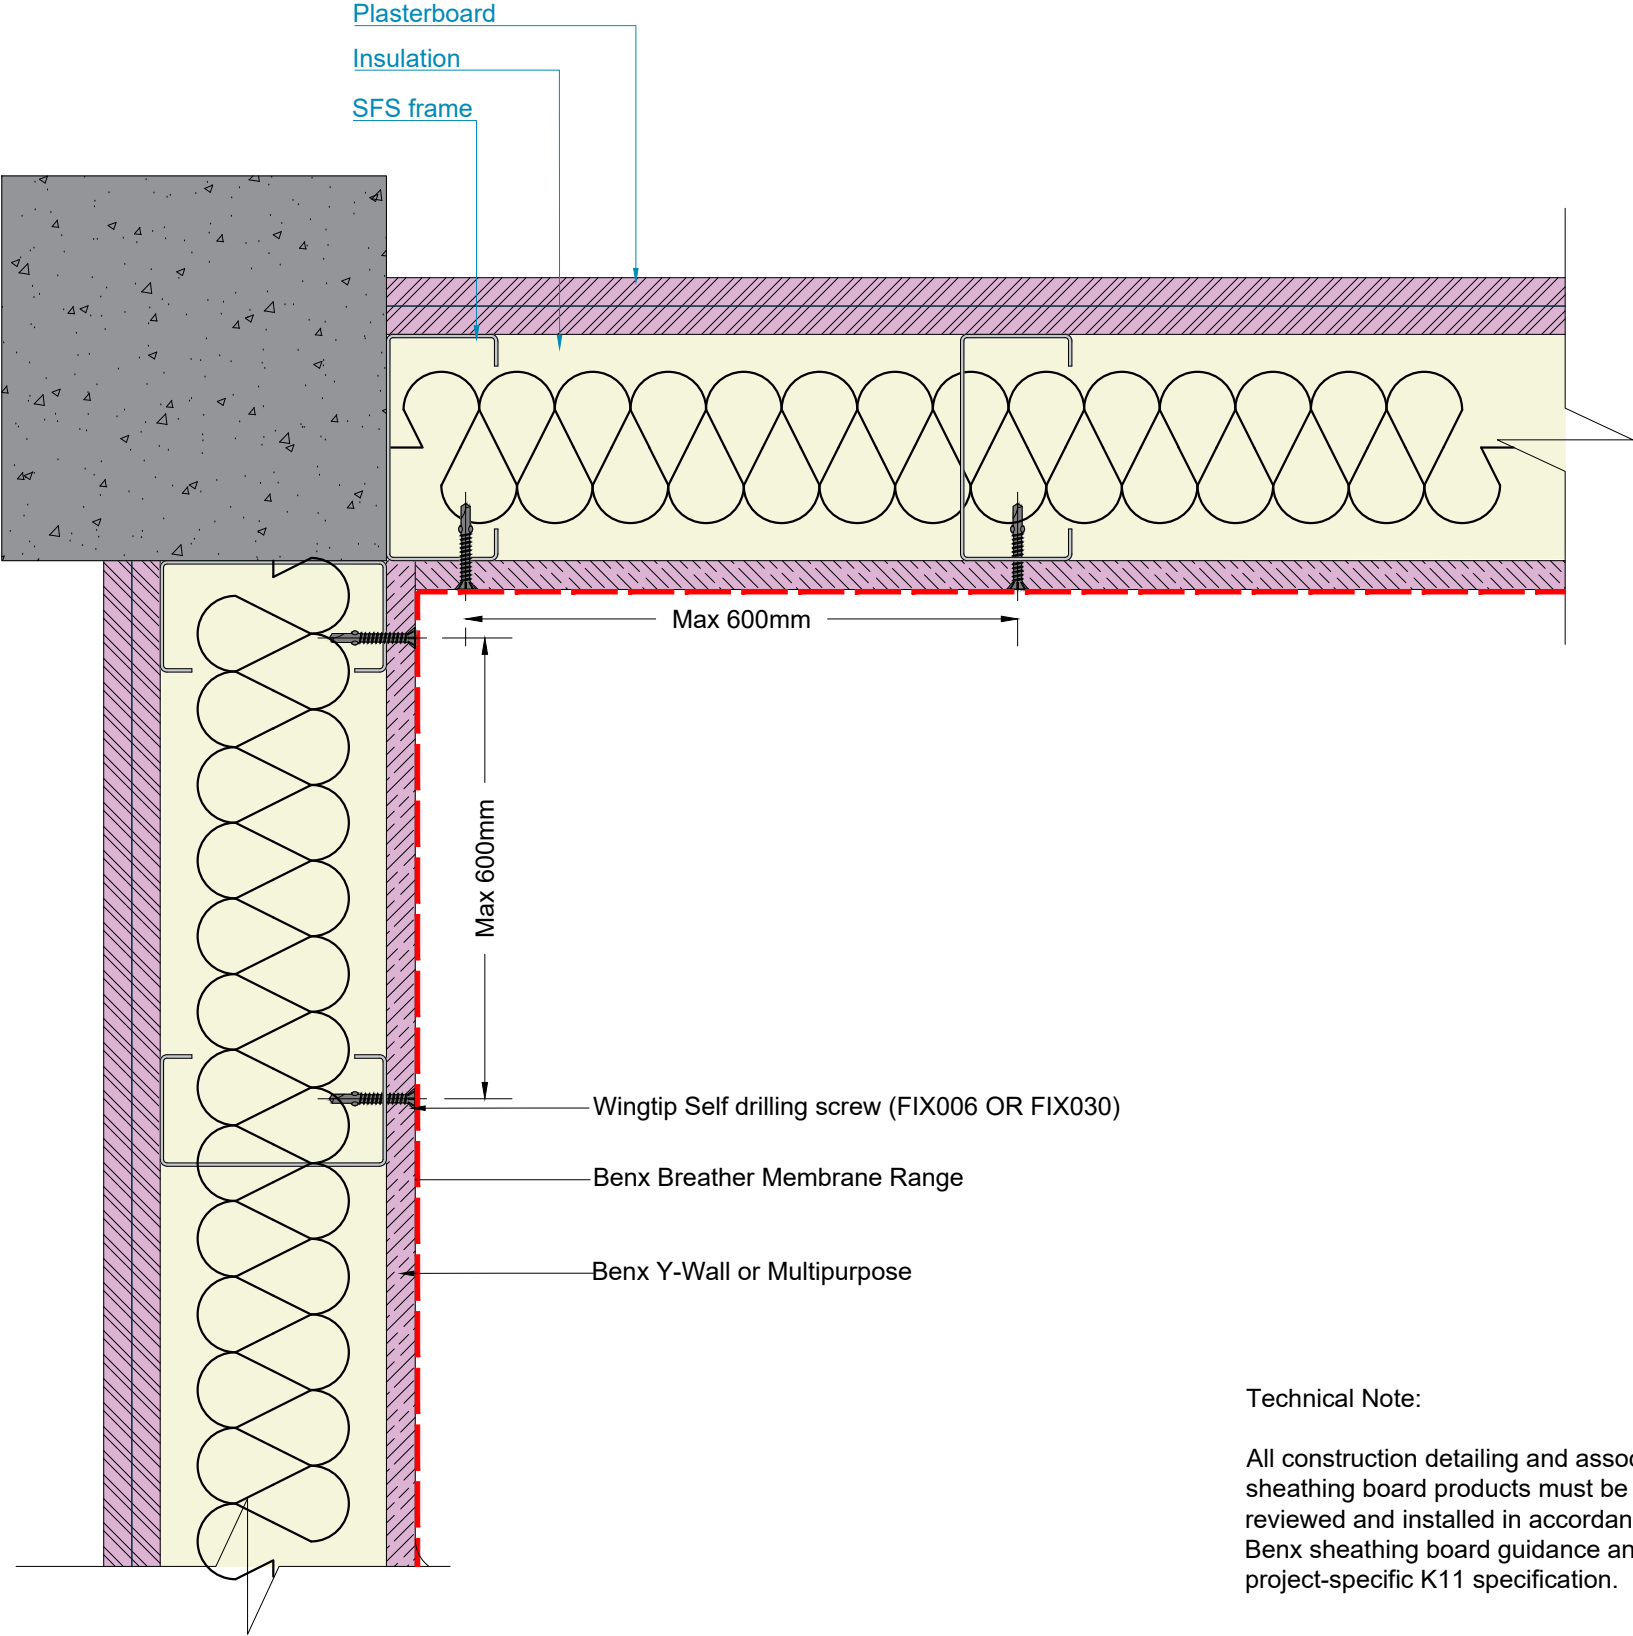

Technical Note:

All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.


Blue Text = By Others

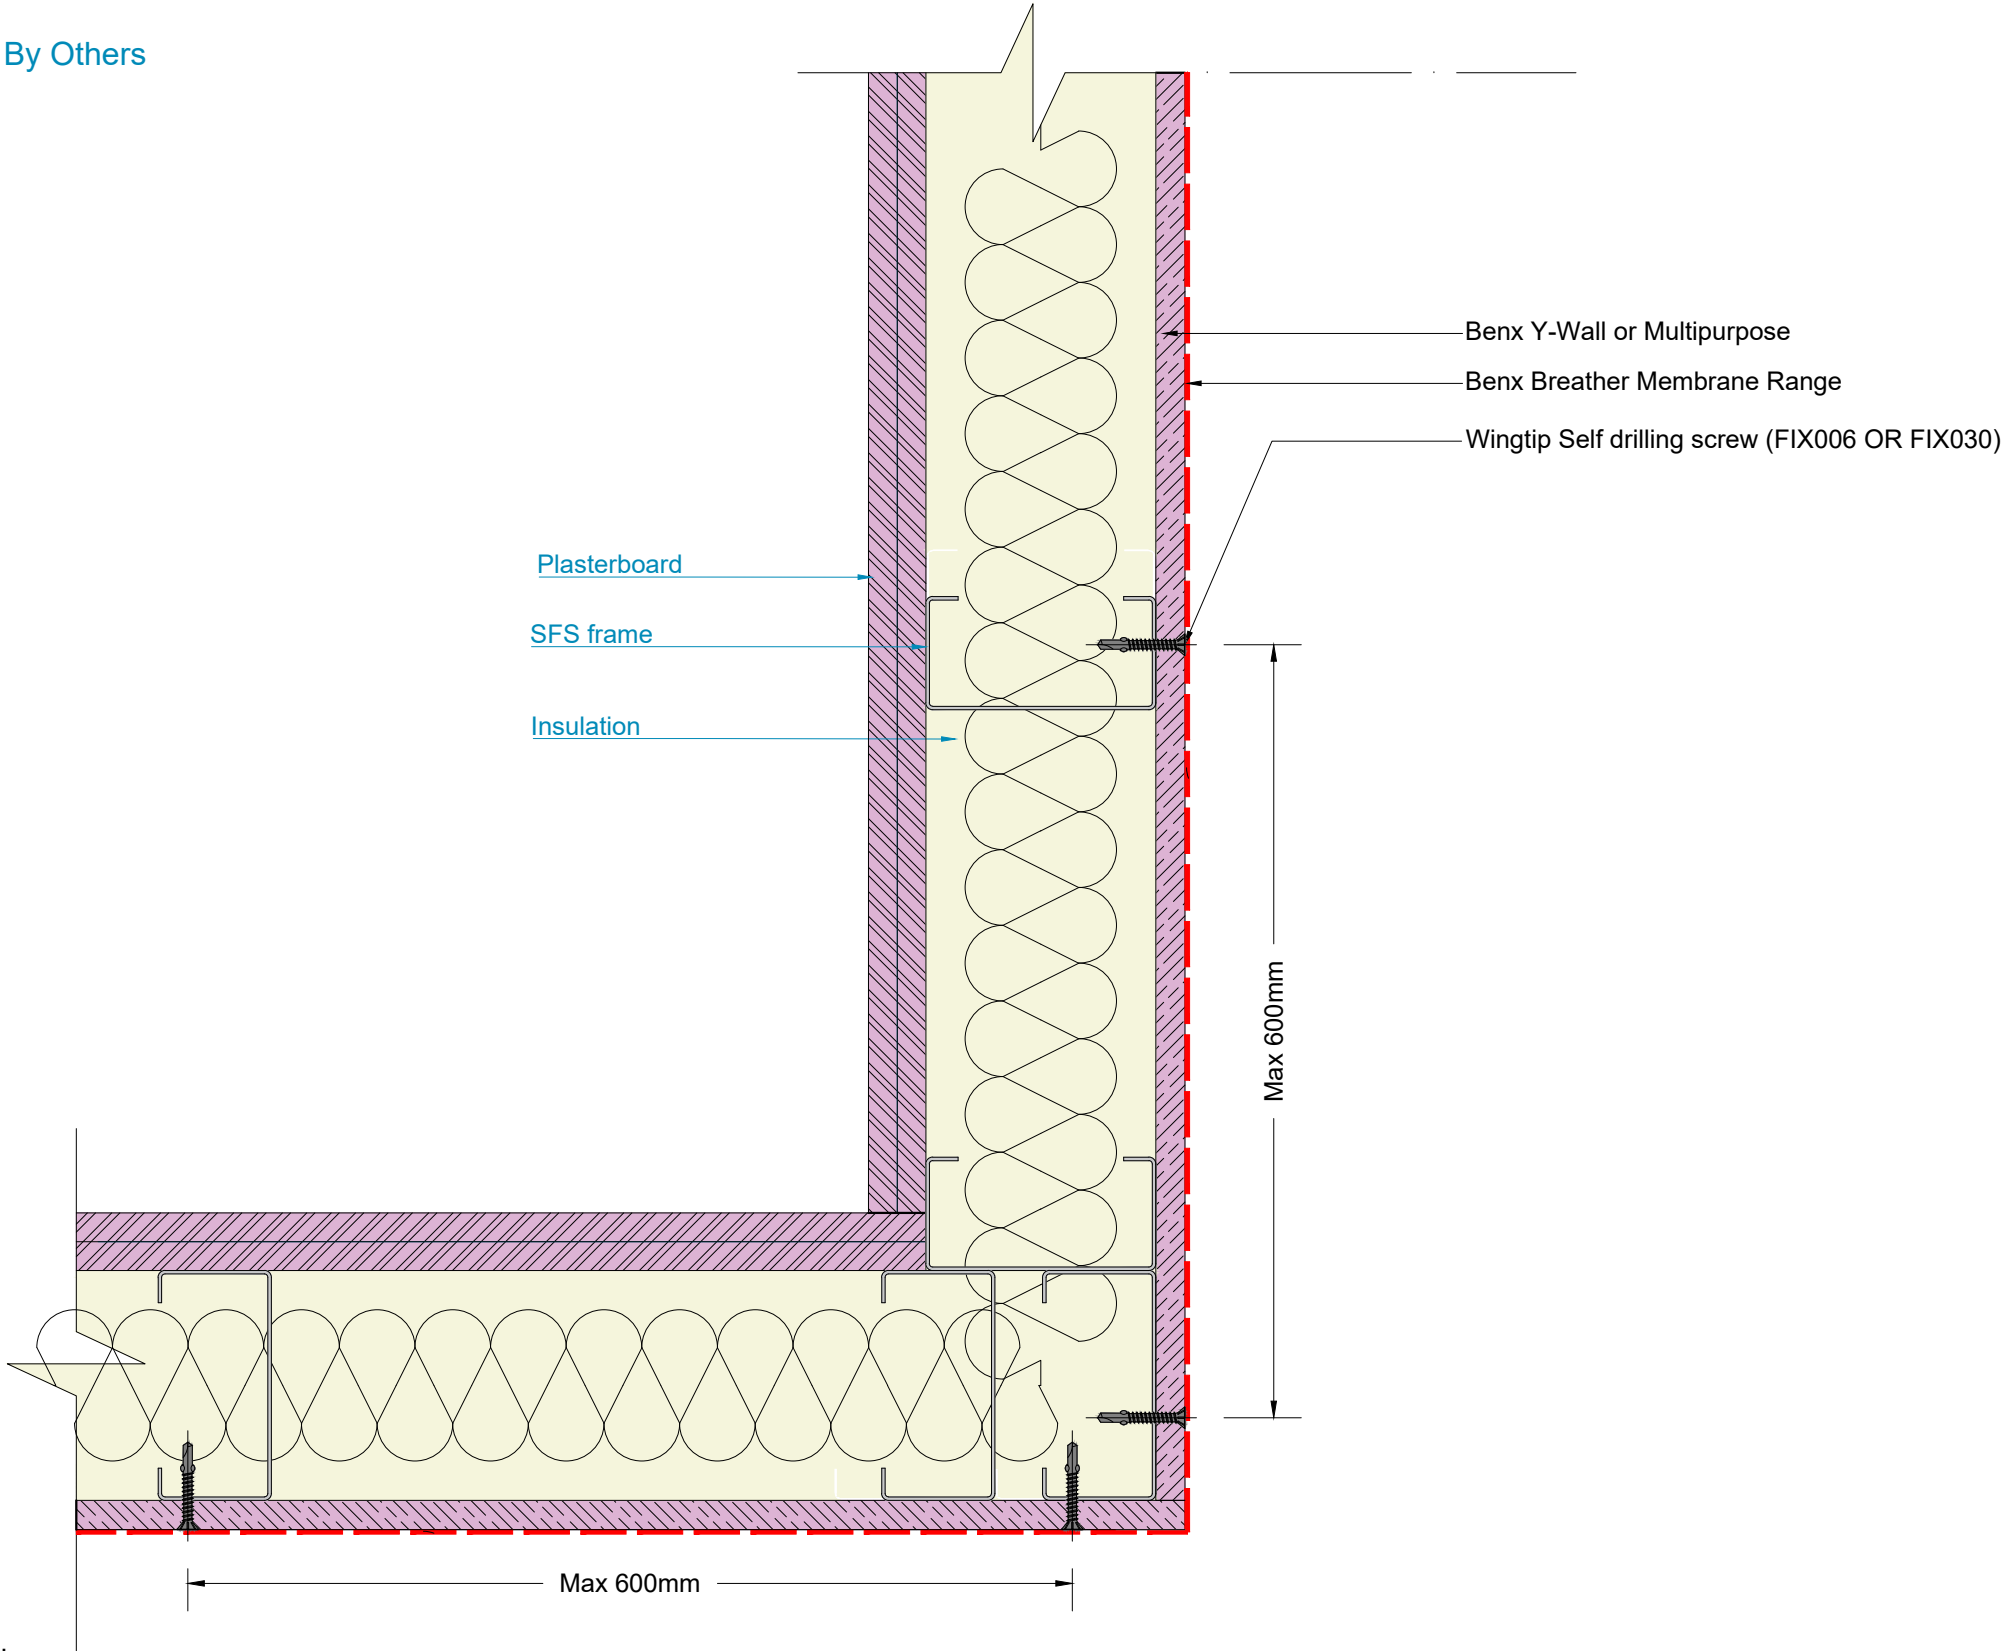

Technical Note:

All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Blue Text = BY OTHERS

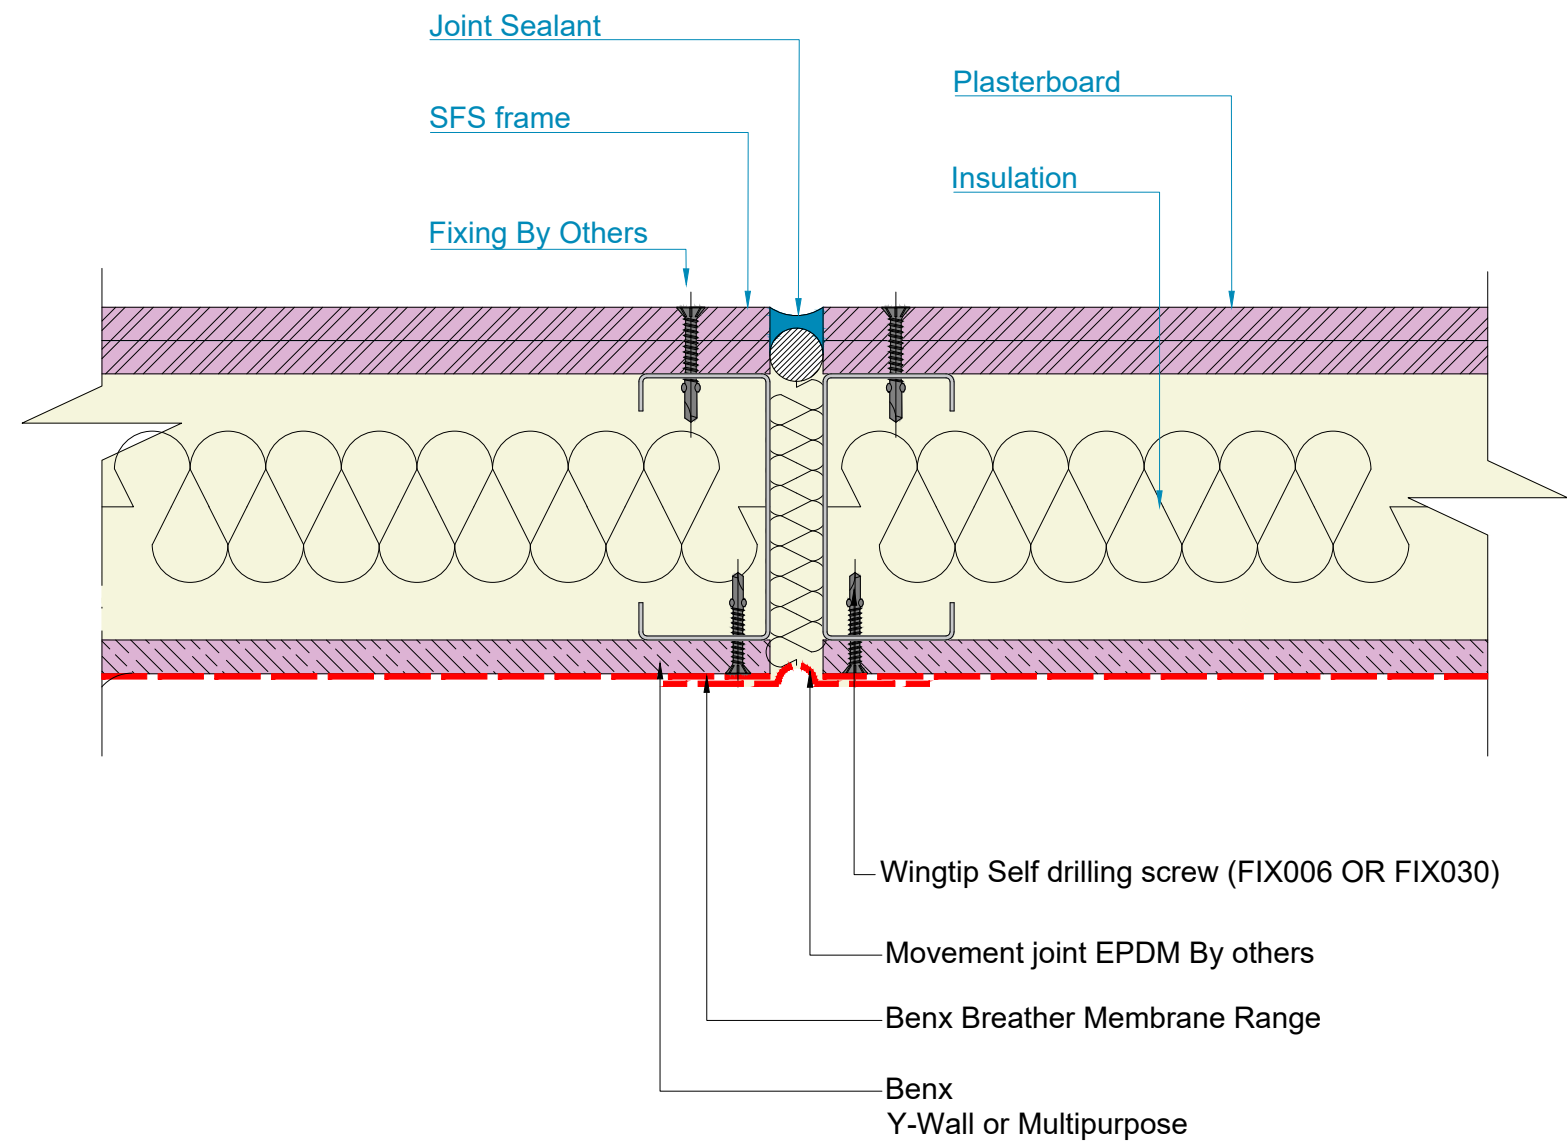

Technical Note:


All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Benx Ltd, Lonsdale Chambers,
Lonsdale Street,
Stoke-on-Trent
Staffordshire
ST4 4BT
Telephone: 0845 130 0983
Email:
technicalservices@benx.co.uk

All performance data & systems specifications are for systems constructed with materials & components as shown. The inclusion or substitution of any other manufactures materials or components invalidates both test data, system performance and compliance with CDM 2015. The information is provided and based upon details received, which are assumed to include all the relevant facts and data. While it is believed to be correct, we accept no liability for its accuracy, adequacy or completeness. Recipients must satisfy themselves as to its suitability as we do not accept responsibility for any claims or consequential loss. Acceptance of the content and subsequent design responsibility rests entirely with the recipients. Any subsequent design changes that affect the detail which we are not informed of in a written format will void this detail. None of the content may be copied without the prior approval from the Benx Group Technical Services Department. This statement should be read in conjunction with the standard terms and conditions of Benx Group.

REV	DATE	NOTE	BY	STATUS:	INFORMATION	DRAWN:
A	01/06/26	First Issue	MB	PROJECT:	Building Boards Typical Details	ISO No: 5450
				DRAWING No:	BB-TD-07	CHECK: DS
				DESCRIPTION:	Typical Movement Joint Detail	DATE: 06/26
						REV: A

Blue Text = BY OTHERS

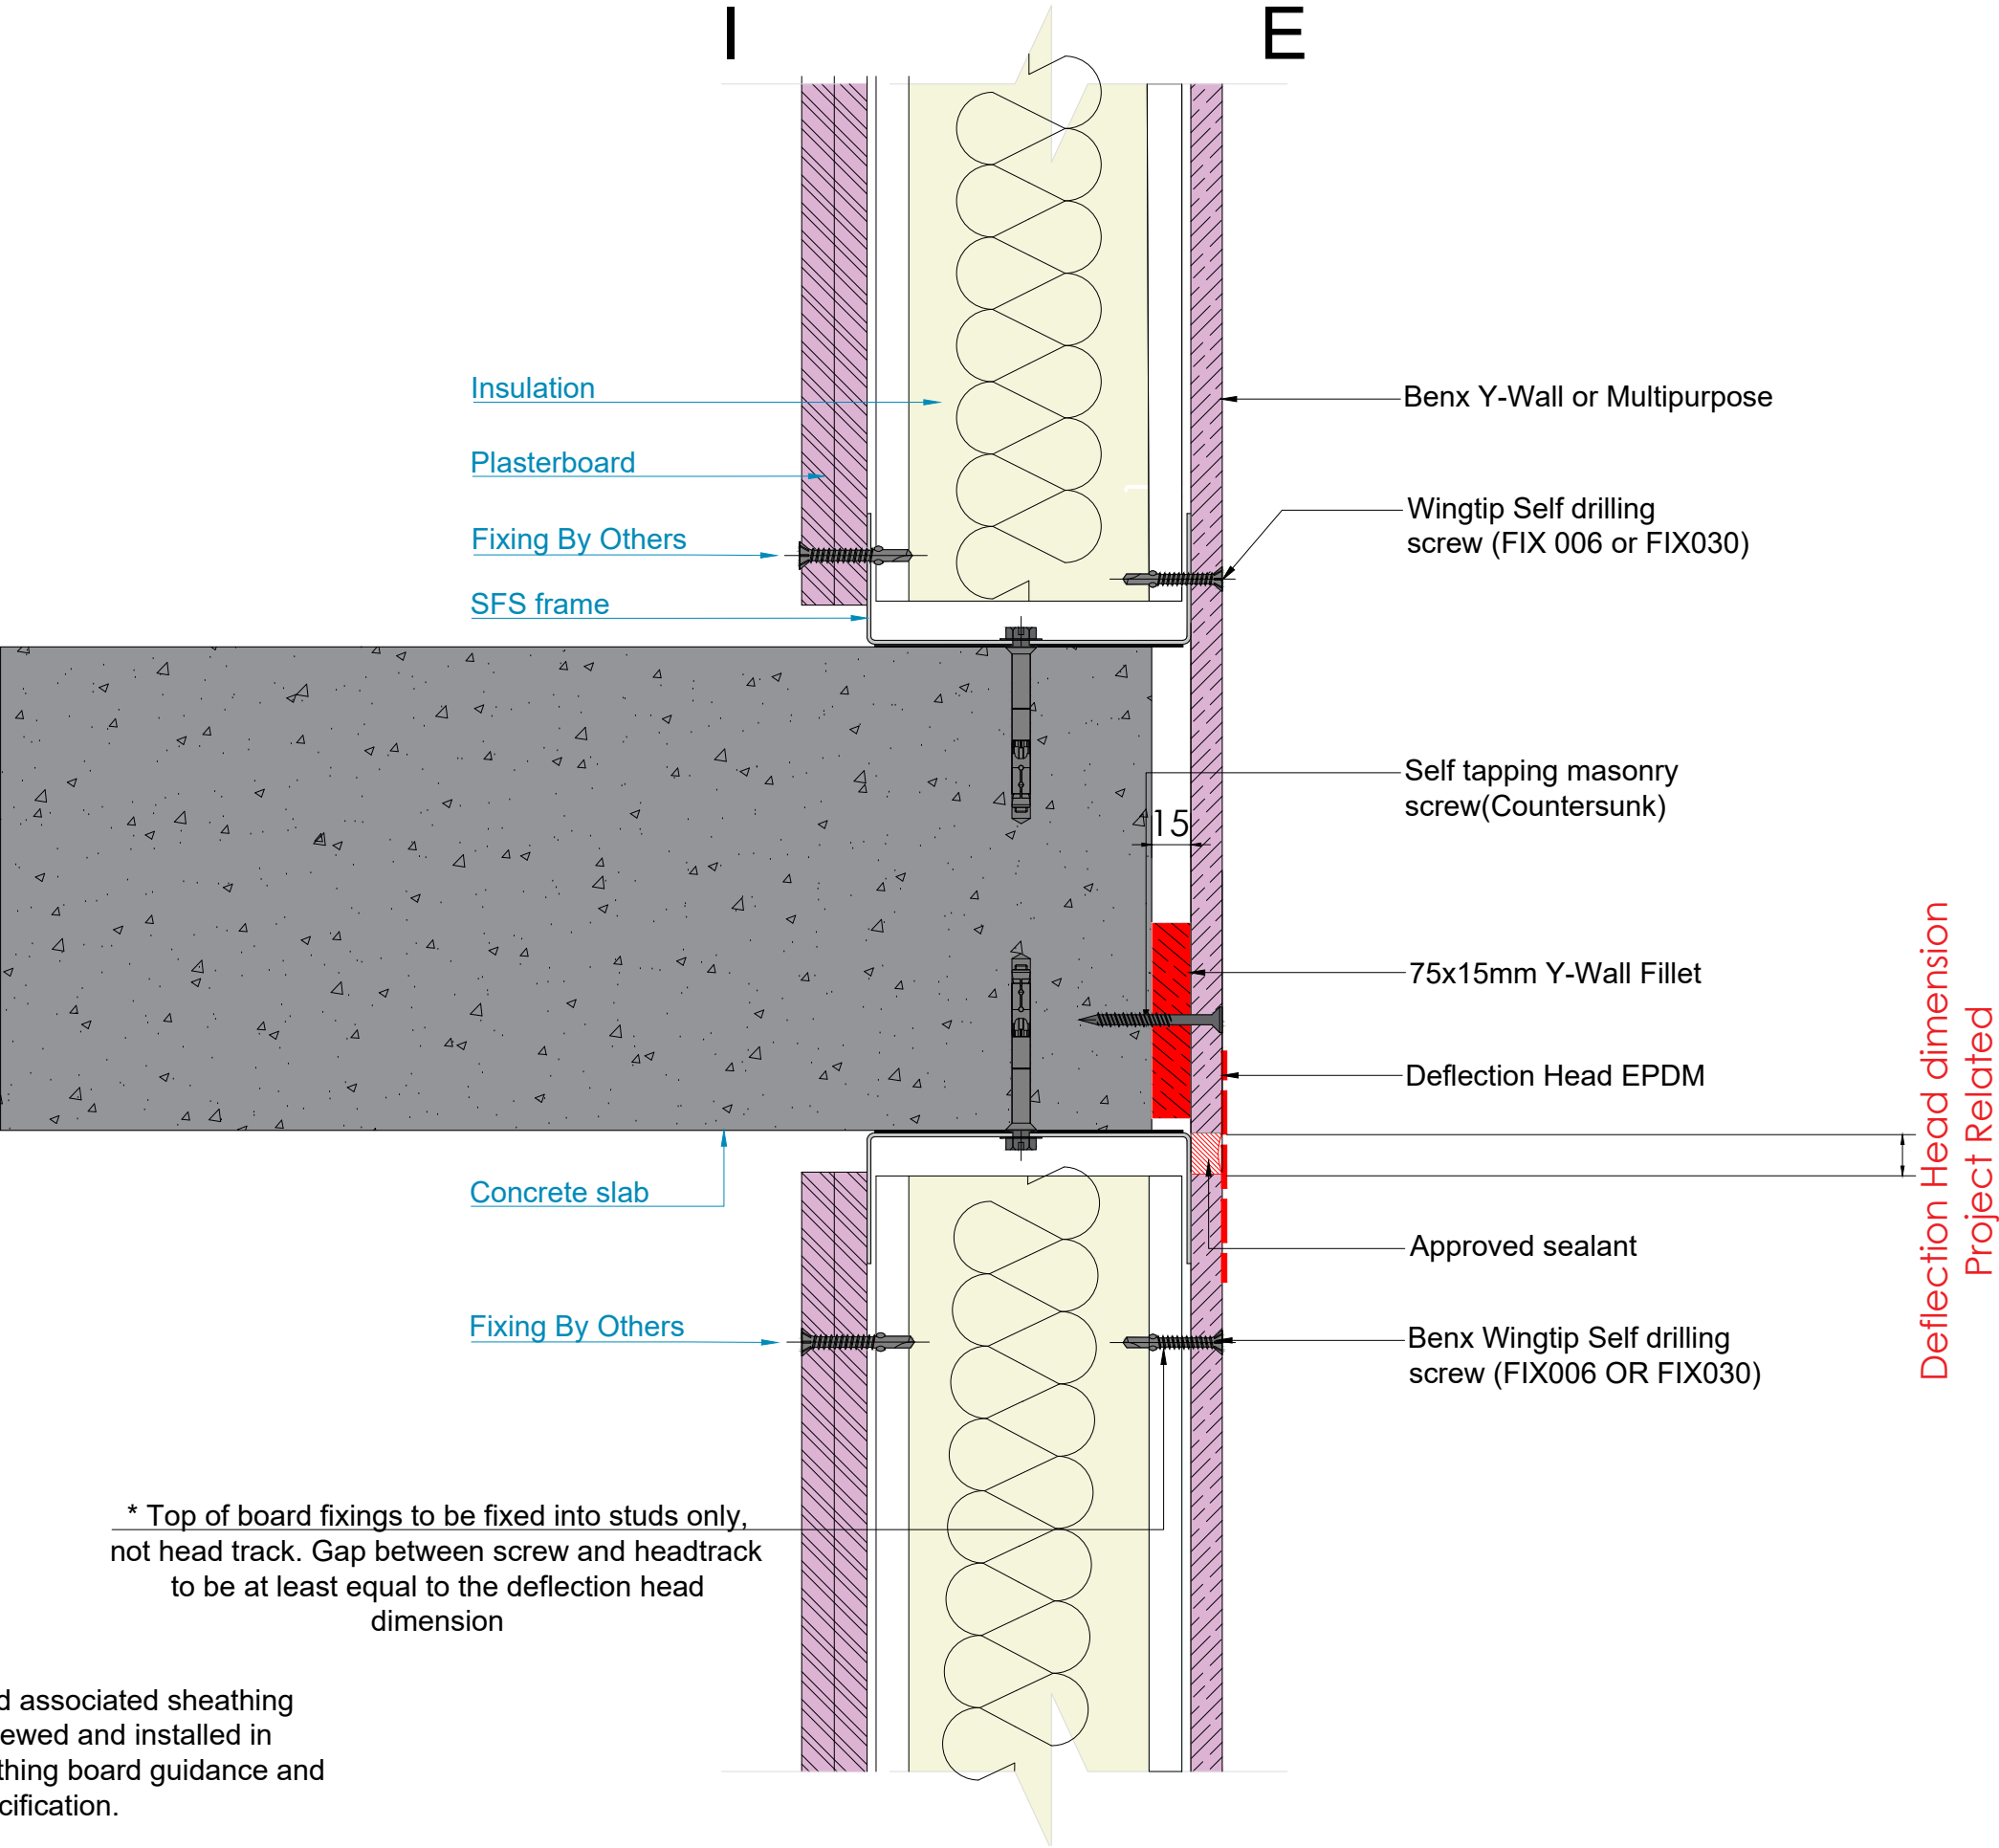

Technical Note:


All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Benx Ltd, Lonsdale Chambers,
Lonsdale Street,
Stoke-on-Trent
Staffordshire
ST4 4BT
Telephone: 0845 130 0983
Email:
technicalservices@benx.co.uk

All performance data & systems specifications are for systems constructed with materials & components as shown. The inclusion or substitution of any other manufactures materials or components invalidates both test data, system performance and compliance with CDM 2015. The information is provided and based upon details received, which are assumed to include all the relevant facts and data. While it is believed to be correct, we accept no liability for its accuracy, adequacy or completeness. Recipients must satisfy themselves as to its suitability as we do not accept responsibility for any claims or consequential loss. Acceptance of the content and subsequent design responsibility rests entirely with the recipients. Any subsequent design changes that affect the detail which we are not informed of in a written format will void this detail. None of the content may be copied without the prior approval from the Benx Group Technical Services Department. This statement should be read in conjunction with the standard terms and conditions of Benx Group.

REV	DATE	NOTE	BY	STATUS:	INFORMATION	DRAWN:
-	01/10/22	First Issue	MB	PROJECT:	ISO No:	MB
A	04/11/22	Joint position	MTM	Building Boards Typical Details	5450	CHECK:
B	26/03/24	Y-Wall Fillet fixing arrangement updated	JT			DS
C	01/06/26	First Issue	MB	DRAWING No: BB-TD-08		NTS@A3
				DESCRIPTION:		DATE:
				DEFLECTION HEAD DETAIL ON FILLET		06/26
						REV:
						A

Blue Text = BY OTHERS

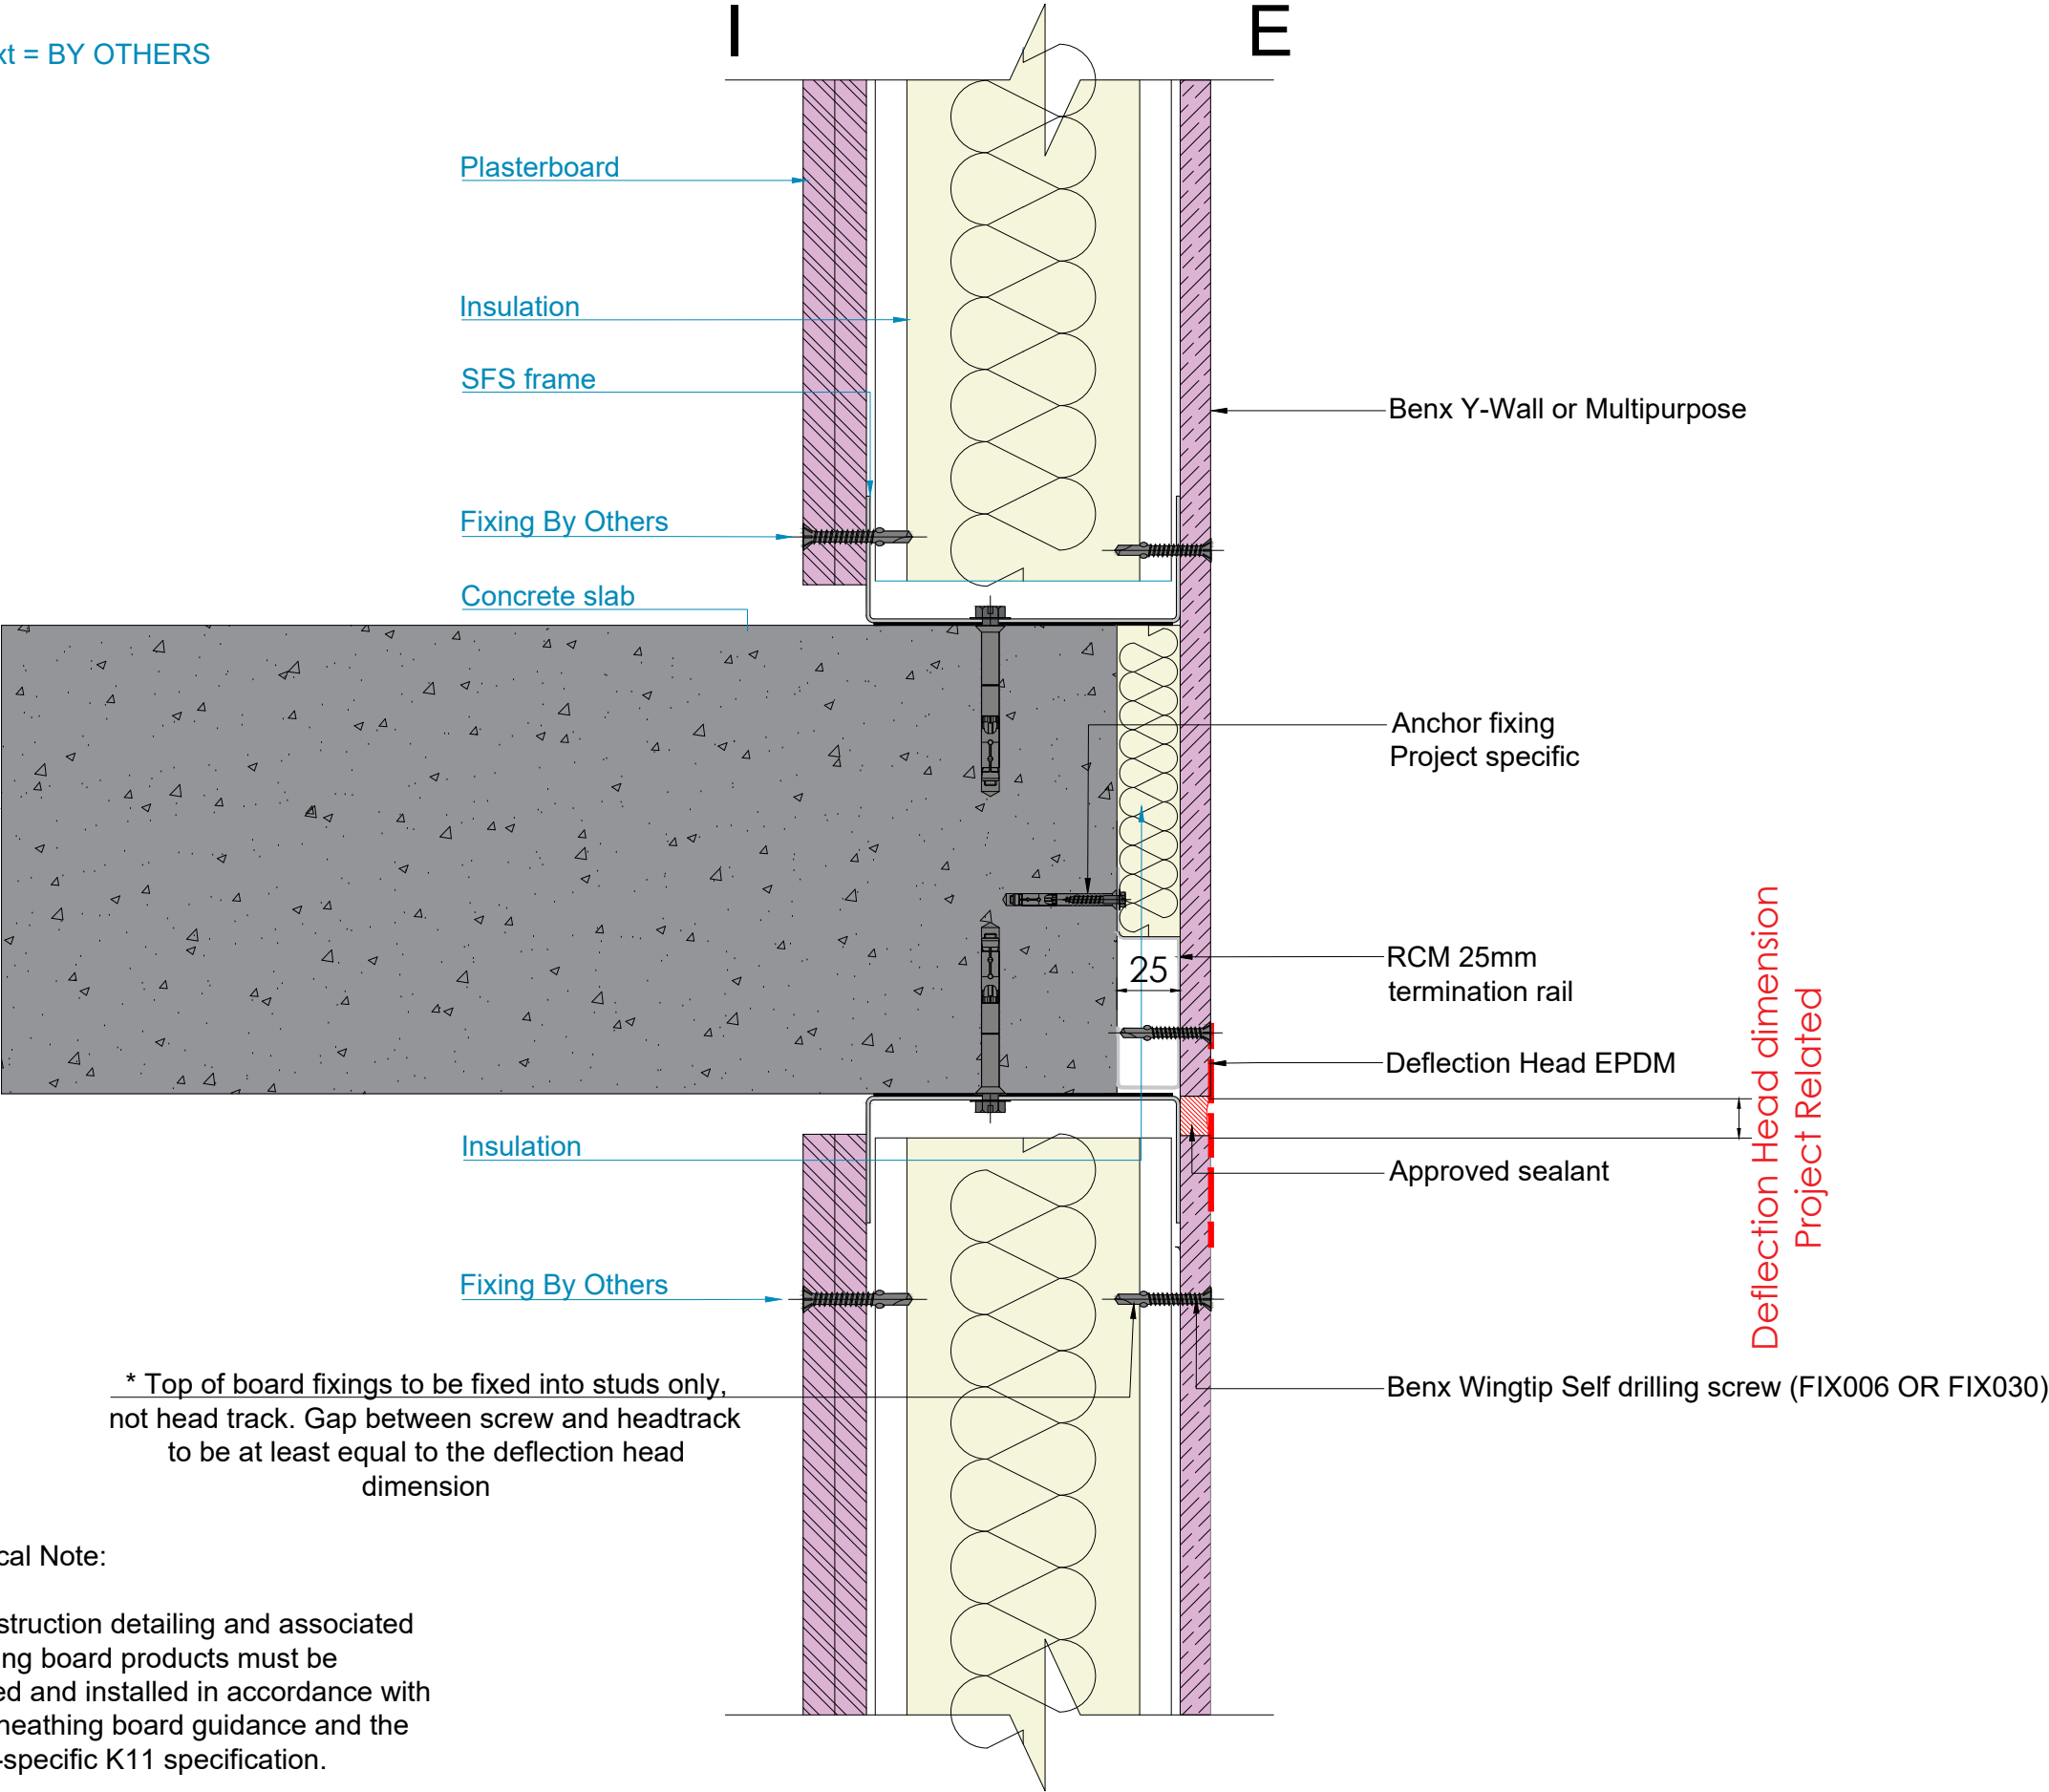

Technical Note:


All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Benx Ltd, Lonsdale Chambers,
Lonsdale Street,
Stoke-on-Trent
Staffordshire
ST4 4BT
Telephone: 0845 130 0983
Email:
technicalservices@benx.co.uk

All performance data & systems specifications are for systems constructed with materials & components as shown. The inclusion or substitution of any other manufactures materials or components invalidates both test data, system performance and compliance with CDM 2015. The information is provided and based upon details received, which are assumed to include all the relevant facts and data. While it is believed to be correct, we accept no liability for its accuracy, adequacy or completeness. Recipients must satisfy themselves as to its suitability as we do not accept responsibility for any claims or consequential loss. Acceptance of the content and subsequent design responsibility rests entirely with the recipients. Any subsequent design changes that affect the detail which we are not informed of in a written format will void this detail. None of the content may be copied without the prior approval from the Benx Group Technical Services Department. This statement should be read in conjunction with the standard terms and conditions of Benx Group.

REV	DATE	NOTE	BY	STATUS:	INFORMATION	DRAWN:
-	-	-	-	PROJECT:	ISO No:	MB
A	04/11/22	Joint position	MTM	Building Boards Typical Details	5450	DS
B	01/06/26	Joint Position	MB	DRAWING No: BB-TD-09		NTS@A3
				DESCRIPTION:		DATE:
				DEFLECTION HEAD DETAIL ON TOP HAT		06/26
						REV:
						A


Blue Text = BY OTHERS

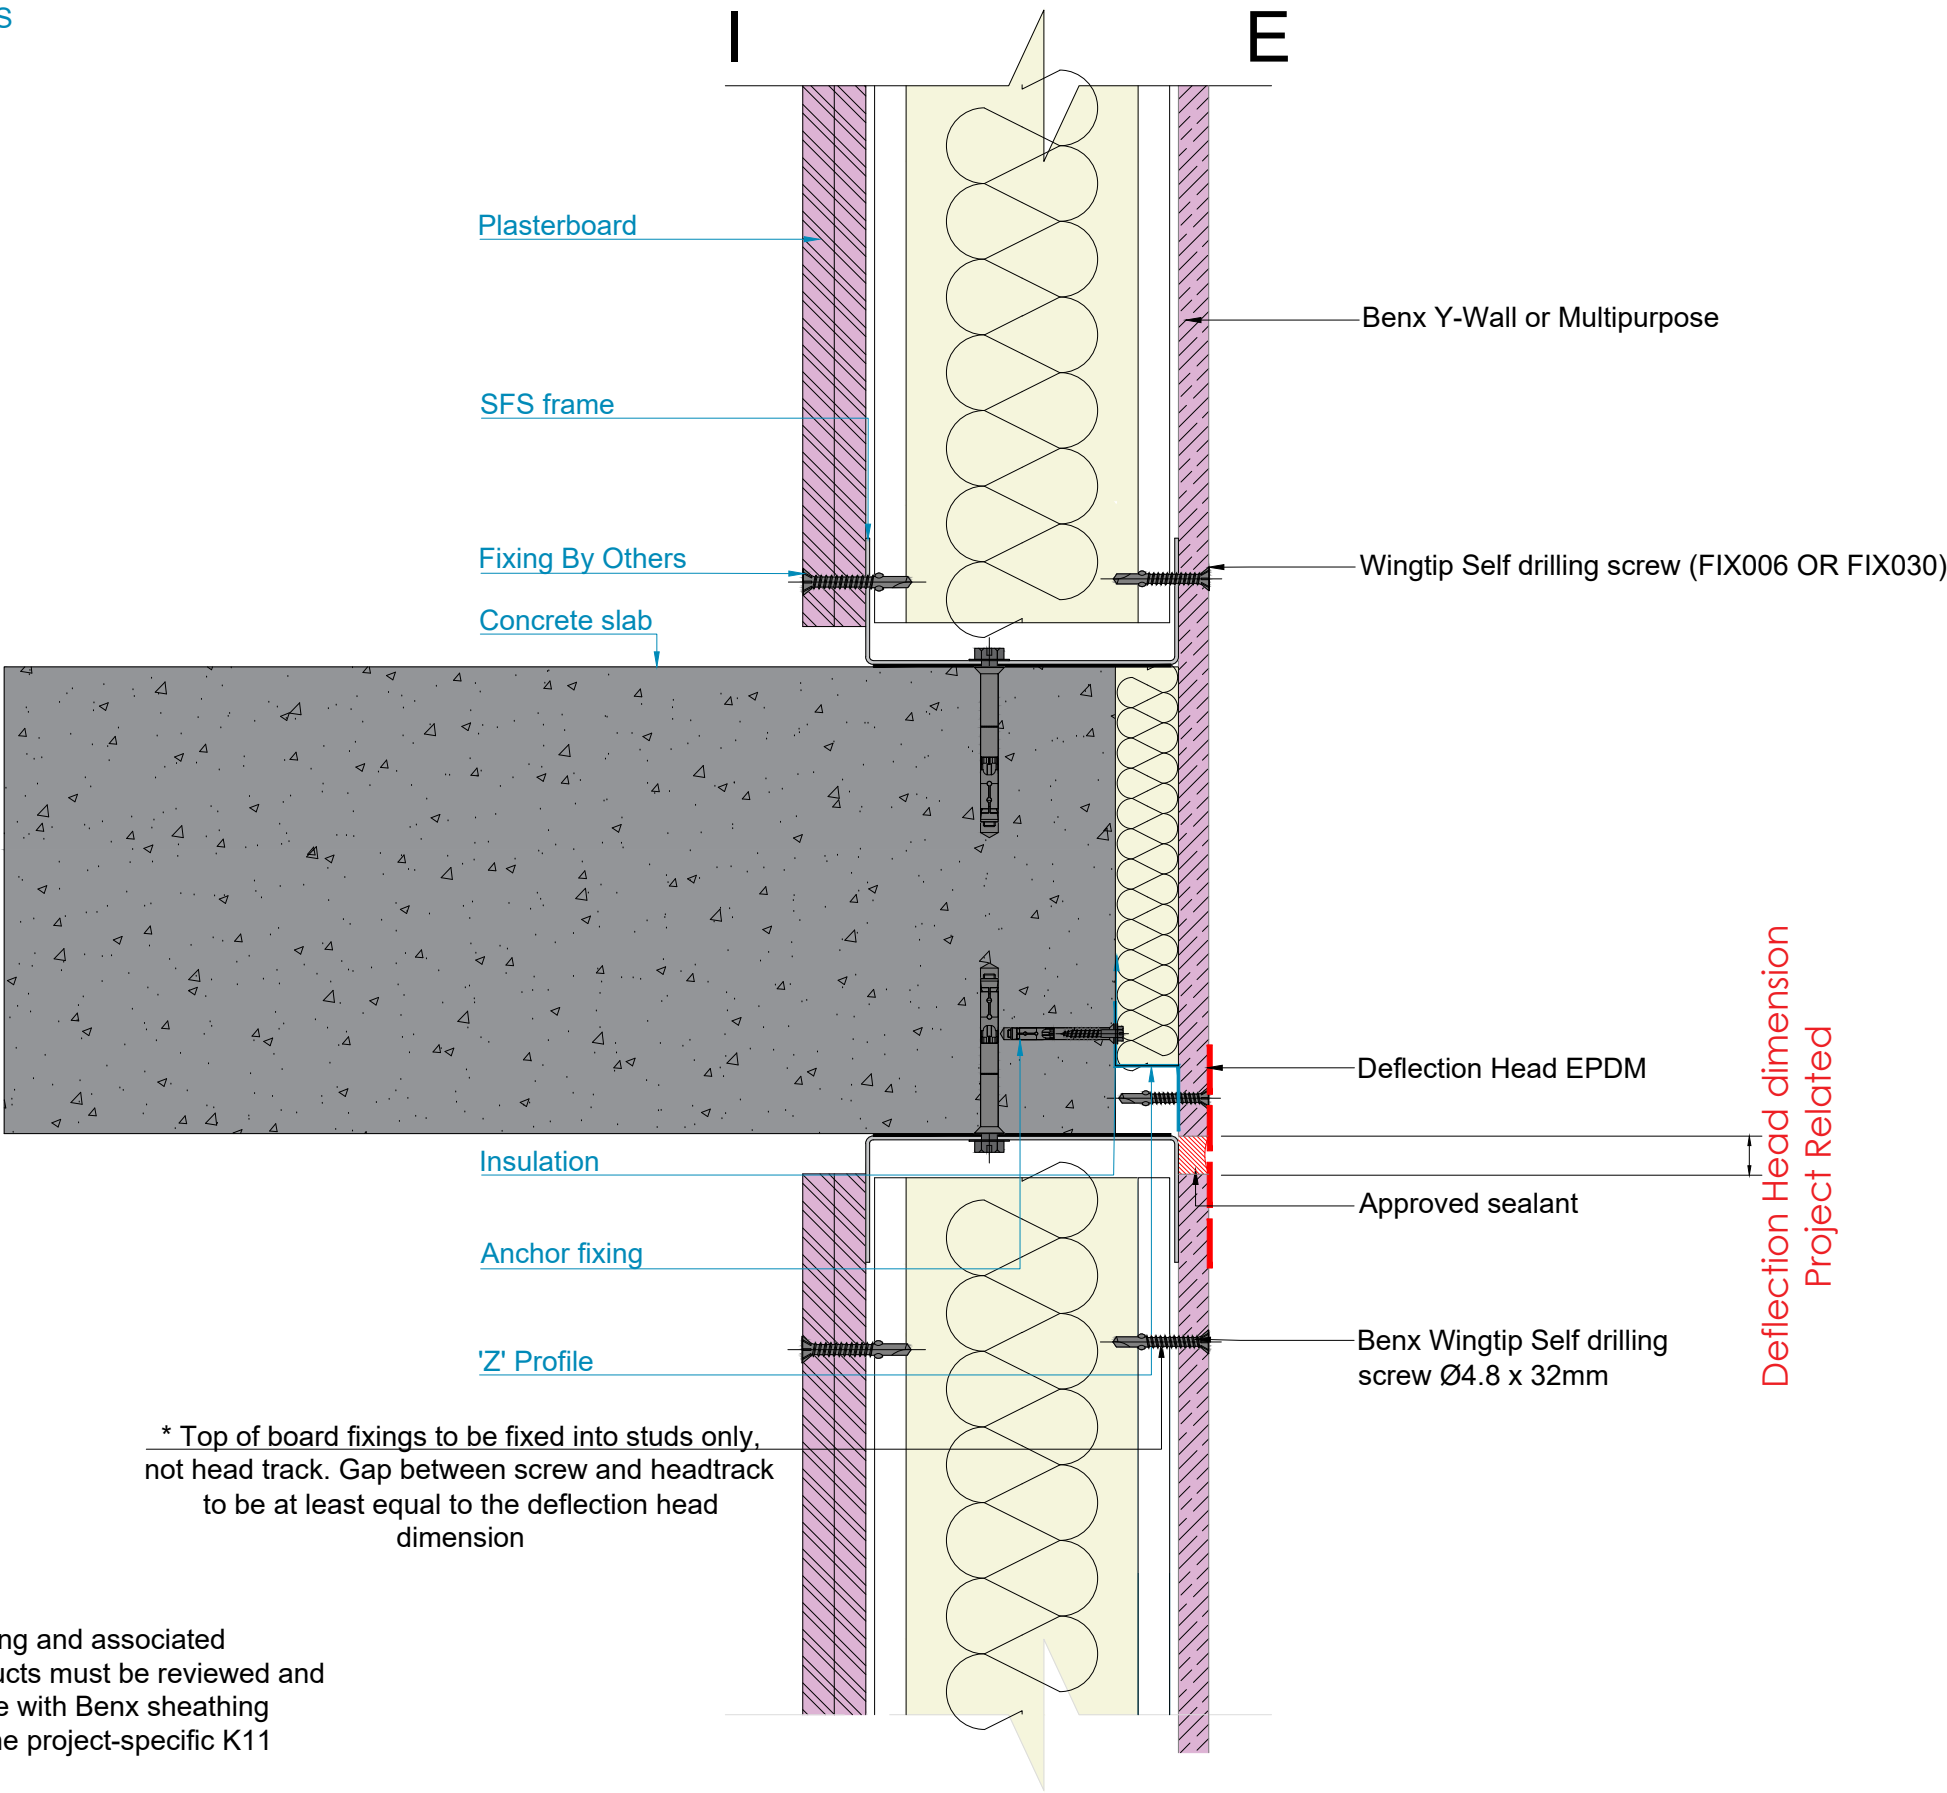

Technical Note:

All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Blue Text = BY OTHERS

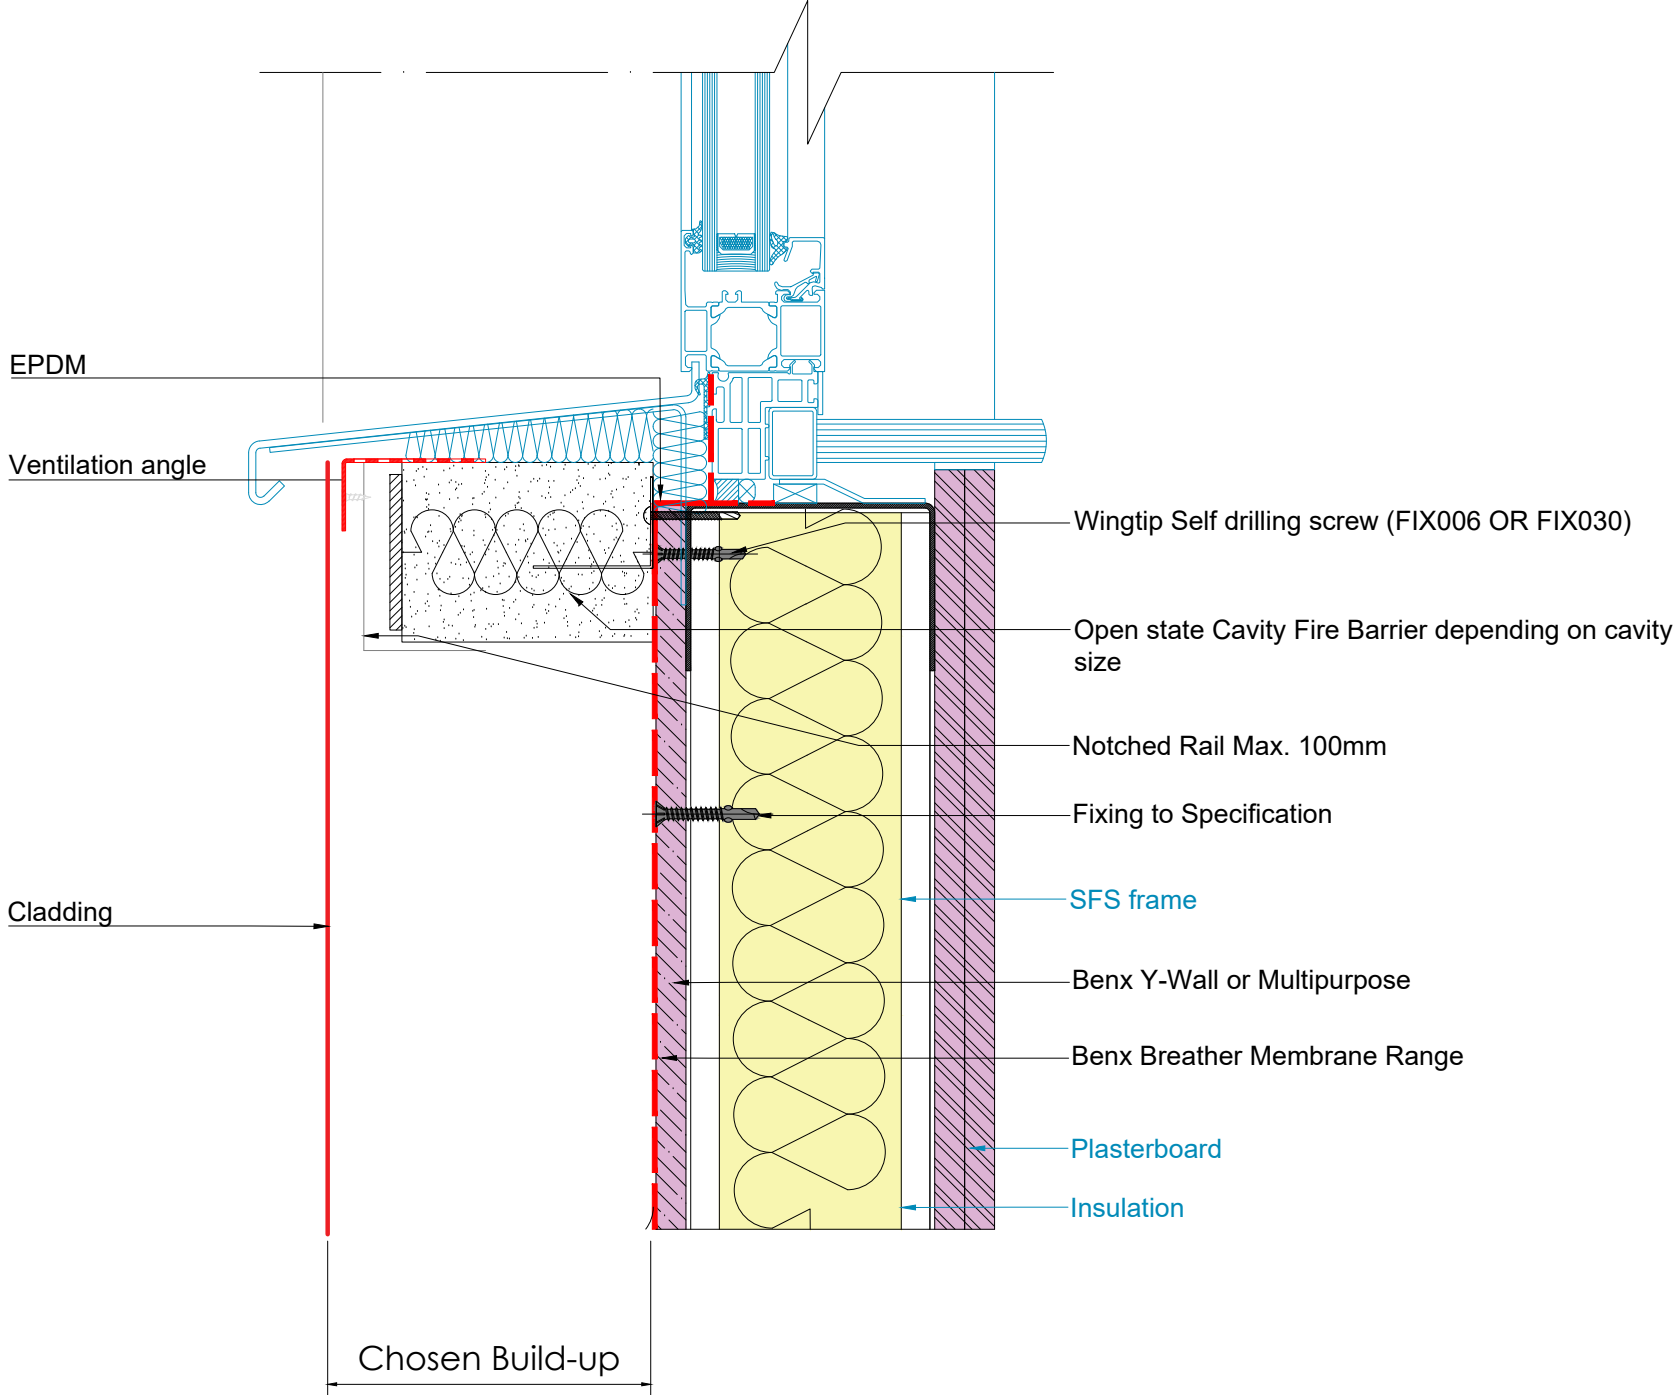

Technical Note:


All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Benx Ltd, Lonsdale Chambers,
Lonsdale Street,
Stoke-on-Trent
Staffordshire
ST4 4BT
Telephone: 0845 130 0983
Email:
technicalservices@benx.co.uk

All performance data & systems specifications are for systems constructed with materials & components as shown. The inclusion or substitution of any other manufactures materials or components invalidates both test data, system performance and compliance with CDM 2015. The information is provided and based upon details received, which are assumed to include all the relevant facts and data. While it is believed to be correct, we accept no liability for its accuracy, adequacy or completeness. Recipients must satisfy themselves as to its suitability as we do not accept responsibility for any claims or consequential loss. Acceptance of the content and subsequent design responsibility rests entirely with the recipients. Any subsequent design changes that affect the detail which we are not informed of in a written format will void this detail. None of the content may be copied without the prior approval from the Benx Group Technical Services Department. This statement should be read in conjunction with the standard terms and conditions of Benx Group.

REV	DATE	NOTE	BY	STATUS:	INFORMATION	DRAWN:
-	-	-	-	PROJECT:	ISO No:	MB
A	01/06/26	First Issue	MB	Building Boards Typical Details	5450	DS
				DRAWING No:	BB-TD-11	NTS@A3
				DESCRIPTION:	Window Cill Detail	DATE:
						06/26
						REV:
						A

Blue Text = BY OTHERS

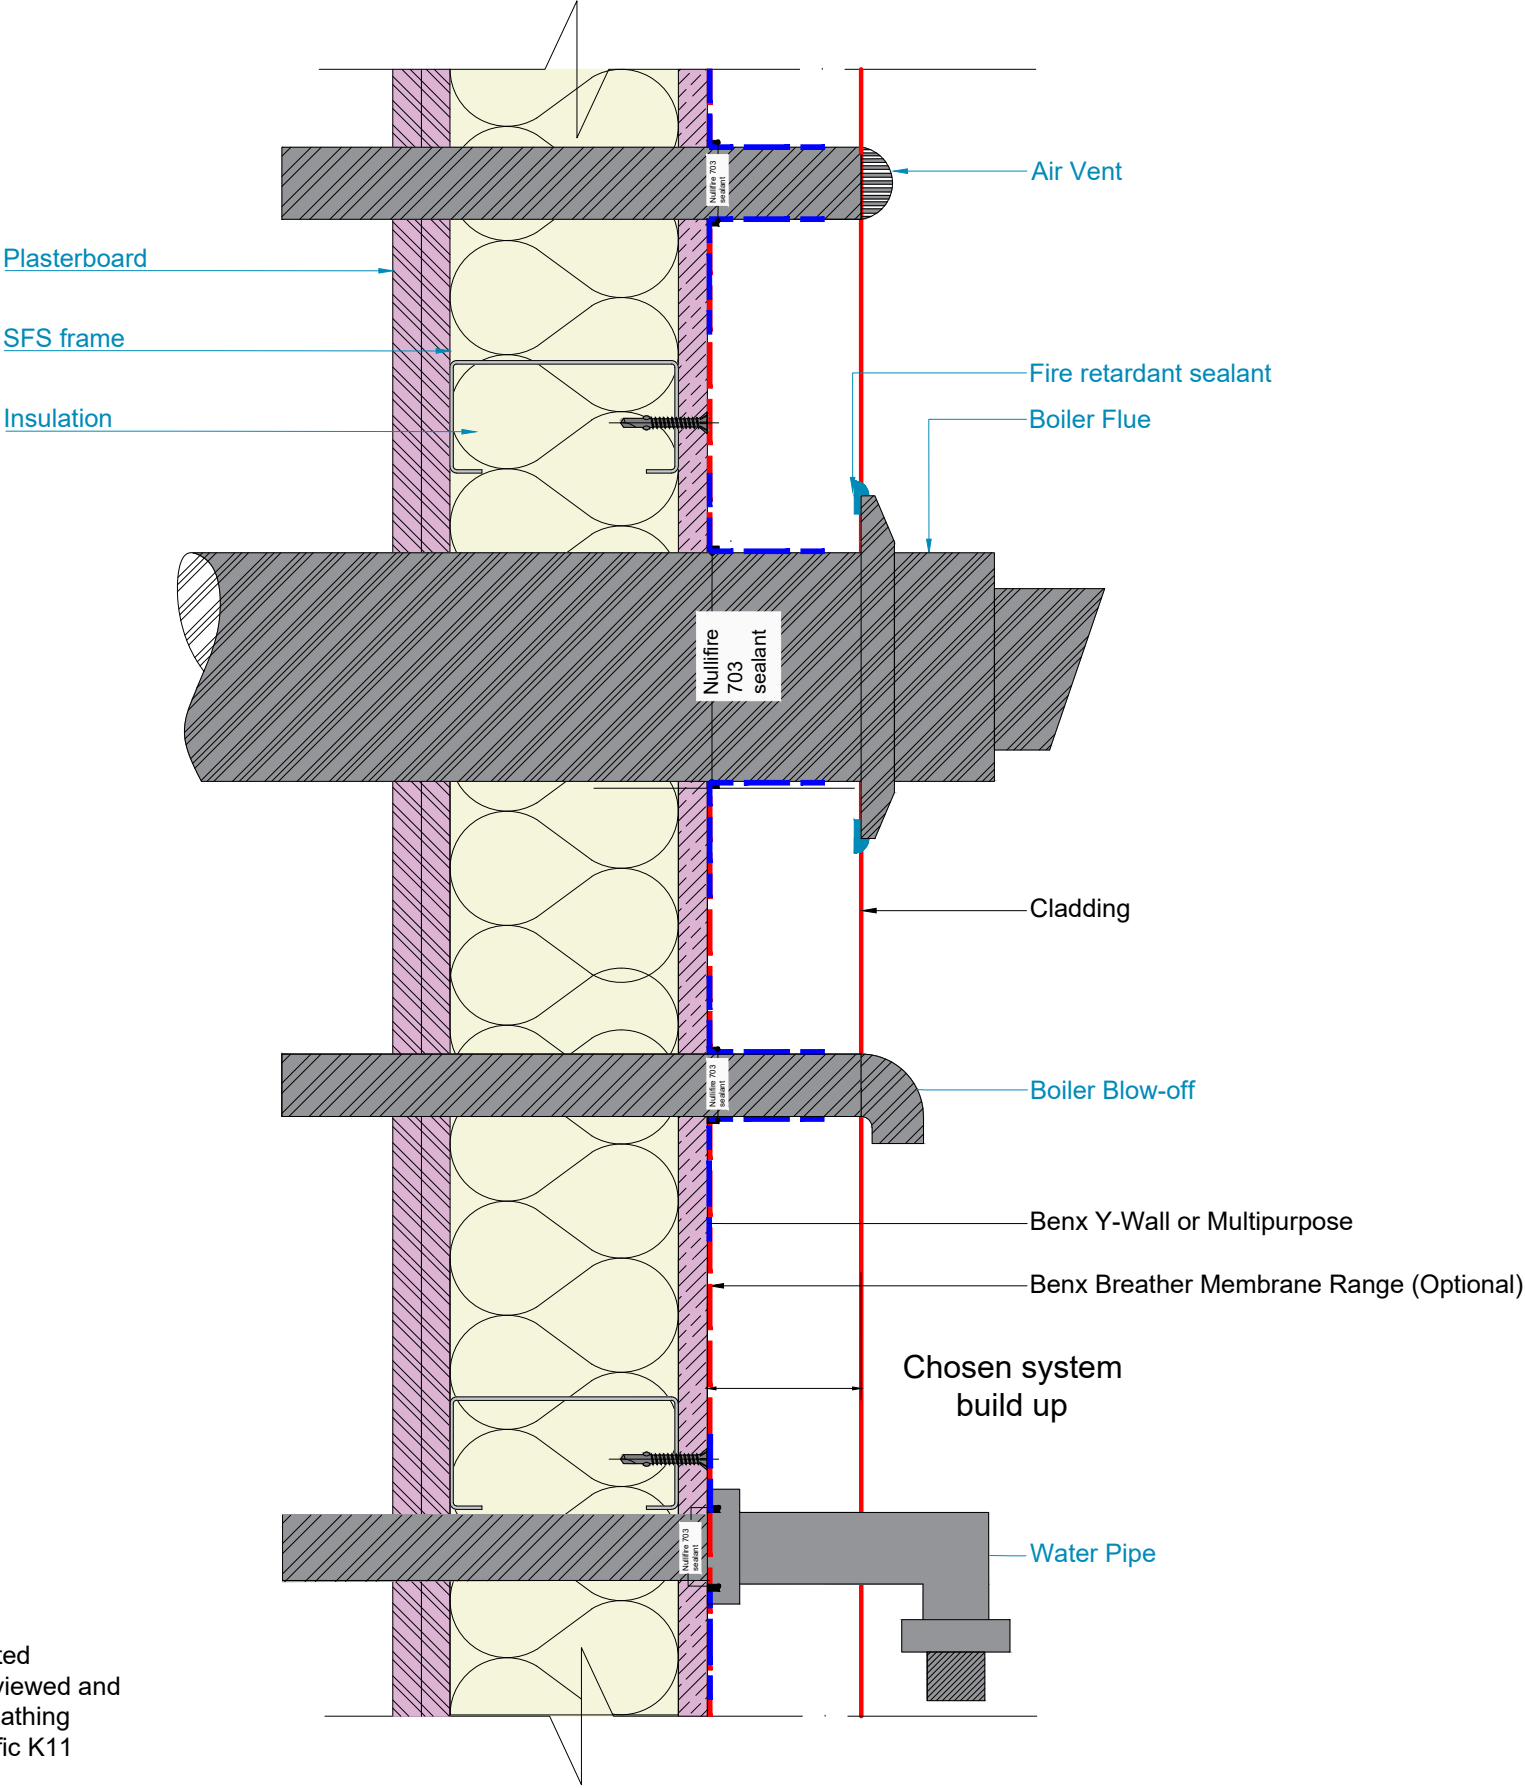

Technical Note:

All construction detailing and associated sheathing board products must be reviewed and installed in accordance with Benx sheathing board guidance and the project-specific K11 specification.

Benx Ltd, Lonsdale Chambers,
Lonsdale Street,
Stoke-on-Trent
Staffordshire
ST4 4BT
Telephone: 0845 130 0983
Email:
technicalservices@benx.co.uk

All performance data & systems specifications are for systems constructed with materials & components as shown. The inclusion or substitution of any other manufactures materials or components invalidates both test data, system performance and compliance with CDM 2015. The information is provided and based upon details received, which are assumed to include all the relevant facts and data. While it is believed to be correct, we accept no liability for its accuracy, adequacy or completeness. Recipients must satisfy themselves as to its suitability as we do not accept responsibility for any claims or consequential loss. Acceptance of the content and subsequent design responsibility rests entirely with the recipients. Any subsequent design changes that affect the detail which we are not informed of in a written format will void this detail. None of the content may be copied without the prior approval from the Benx Group Technical Services Department. This statement should be read in conjunction with the standard terms and conditions of Benx Group.

REV	DATE	NOTE	BY	STATUS:	INFORMATION	DRAWN:
A	01/06/26	First Issue	MB	PROJECT:	Building Boards Typical Details	MB
				ISO No:	5450	CHECK:
				DRAWING No:	BB-TD-12	DS
				DESCRIPTION:	Typical Service Penetration Details	NTS@A3
						DATE:
						06/26
						REV:
						A